




**CEN/TS 1187:2012, test 4
on ClassicBond EPDM
1.2mm on a plywood
deck**

Prepared for:
Flex-R Ltd
Unit 5 Central Park
Bellfield Road
High Wycombe
Bucks
HP13 5HG

6th December 2012
Test report number 282045A
revision 1



0578

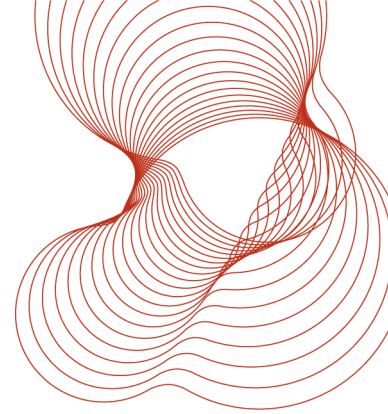

3 Conditioning

The specimens were conditioned as required by the standard.

4 Results

4.1 The testing conditions were as required by the standard.

4.2 Preliminary ignition test

Specimen reference	Ambient	Joint	Flame spread mm	Flame duration min:s	Penetration min:s
E5186-6	20.1°C 64.1%RH	None	0	0:00	None

4.3 Penetration test

Specimen reference	Ambient	Joint	Penetration min:s	Observations
E5186-7	20.1°C 64.1%RH	Apparent pre-made joint in membrane	None	No ignition, large bulge in membrane
E5186-4	22.5°C 54.8%RH	None	None	No ignition, large bulge in membrane
E5186-5	25.6°C 40.1%RH	Membrane	None	Ignited at joint, large bulge in membrane

4.4 No dripping of material occurred from the underside of any specimen tested, nor was any mechanical failure, or development of holes, observed.